


NOTES

FEEDER PER TABLE 310.12(D)

1. MAIN BKR MUST BE LOCATED OUTSIDE PER 2020 NEC 230:85
2. SURGE PROTECTION DEVICE REQUIRED PER 2020 NEC 230:67

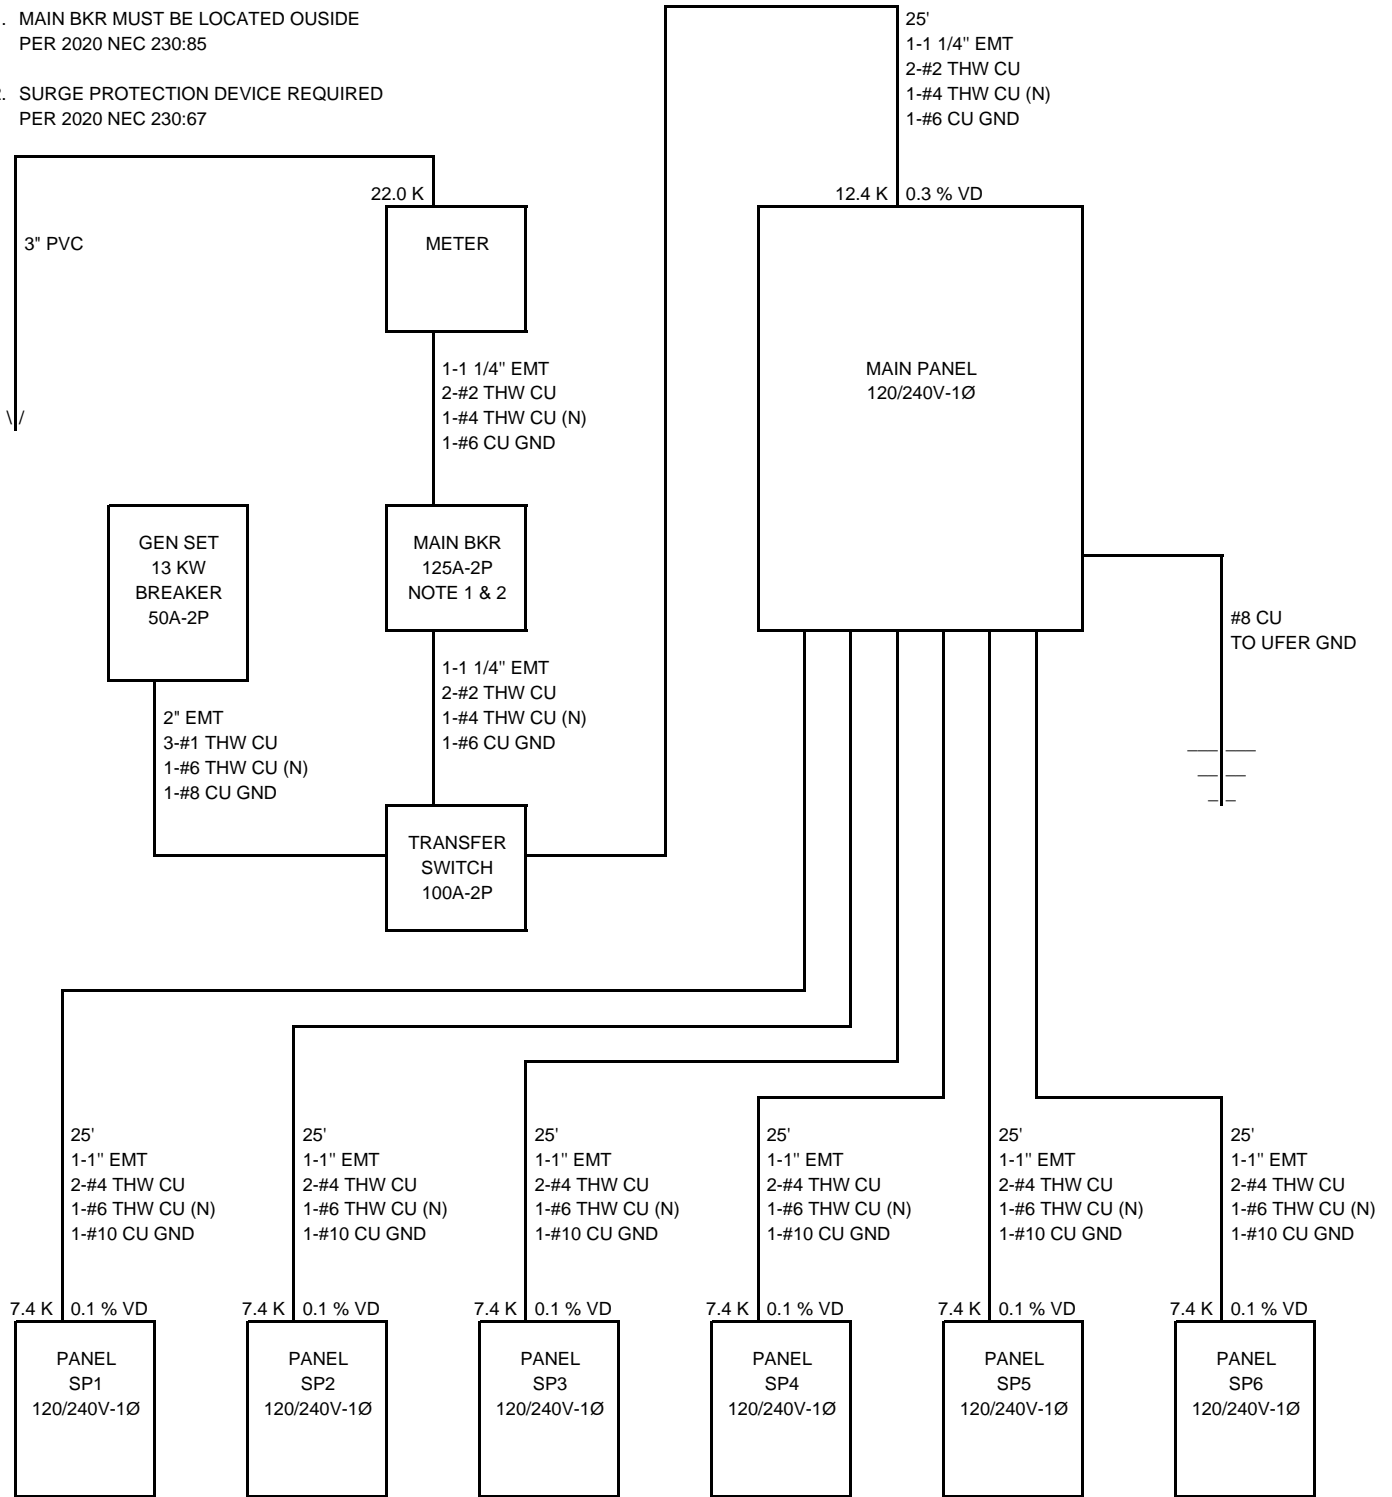

- SP1 - FEEDER PER TABLE 310.12(D)
- SP2 - FEEDER PER TABLE 310.12(D)
- SP3 - FEEDER PER TABLE 310.12(D)
- SP4 - FEEDER PER TABLE 310.12(D)
- SP5 - FEEDER PER TABLE 310.12(D)
- SP6 - FEEDER PER TABLE 310.12(D)

1-LINE DRAWING

SAMPLE
123 MAIN
FOLSOM, CA 95630